


Procedure to Replace Concrete Baffle

Detail to replace a Broken Concrete Baffle
when more than 1 inch of PVC pipe extends
into the tank

Needed PVC Pieces:

- 1 each - 4 inch Schedule 40 PVC Sanitary Tee
- 1 each - 4 inch Schedule 40 PVC, 3 to 4 inches in length
- 1 each - 4 inch Schedule 40 PVC, 8 inches in length
- 1 each - 4 inch Schedule 40 PVC Coupling

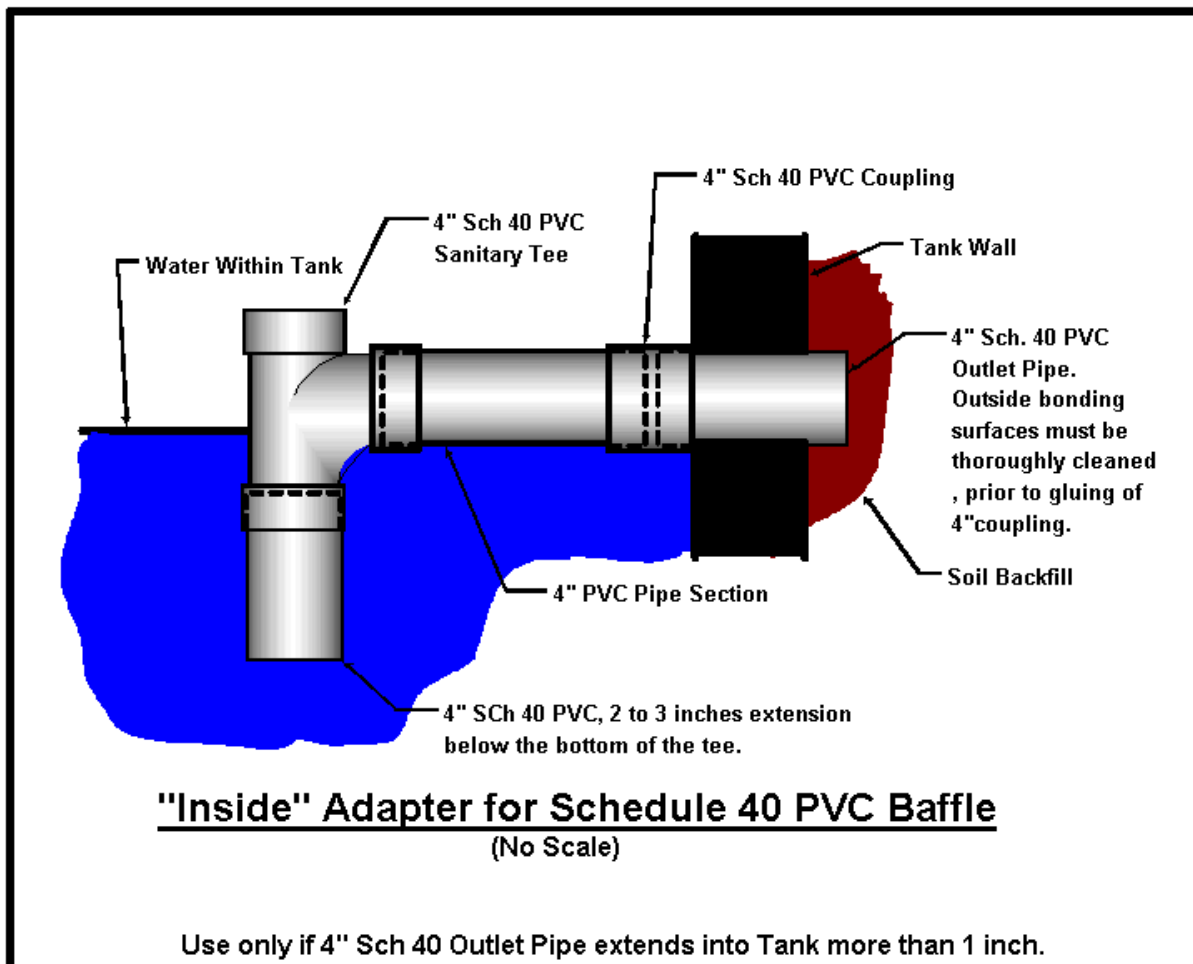

CLERMONT COUNTY GENERAL HEALTH DISTRICT Division of Water & Waste			
Title: Broken Baffle Fact Sheet - More Than 1 Inch of Pipe			
Drawn by: GMV	Date: 9/20/04	Revised by: 1D	