


Procedure to Replace Concrete Baffle

Detail to replace a Broken Concrete Baffle when less than 1 inch of PVC pipe extends into the tank

Needed PVC Pieces:

- 1 each - 4 inch schedule 40 PVC Sanitary Tee
- 1 each - 4 inch schedule 40 PVC, 3 to 4 inches in length
- 1 each - 4 inch schedule 40 PVC, 3 inches in length.
- 2 each - 3 inch schedule 40 Coupling, Ridges and high spots on exterior to be smoothed
- 1 each - 3 inch schedule 40 PVC, 4 inches in length

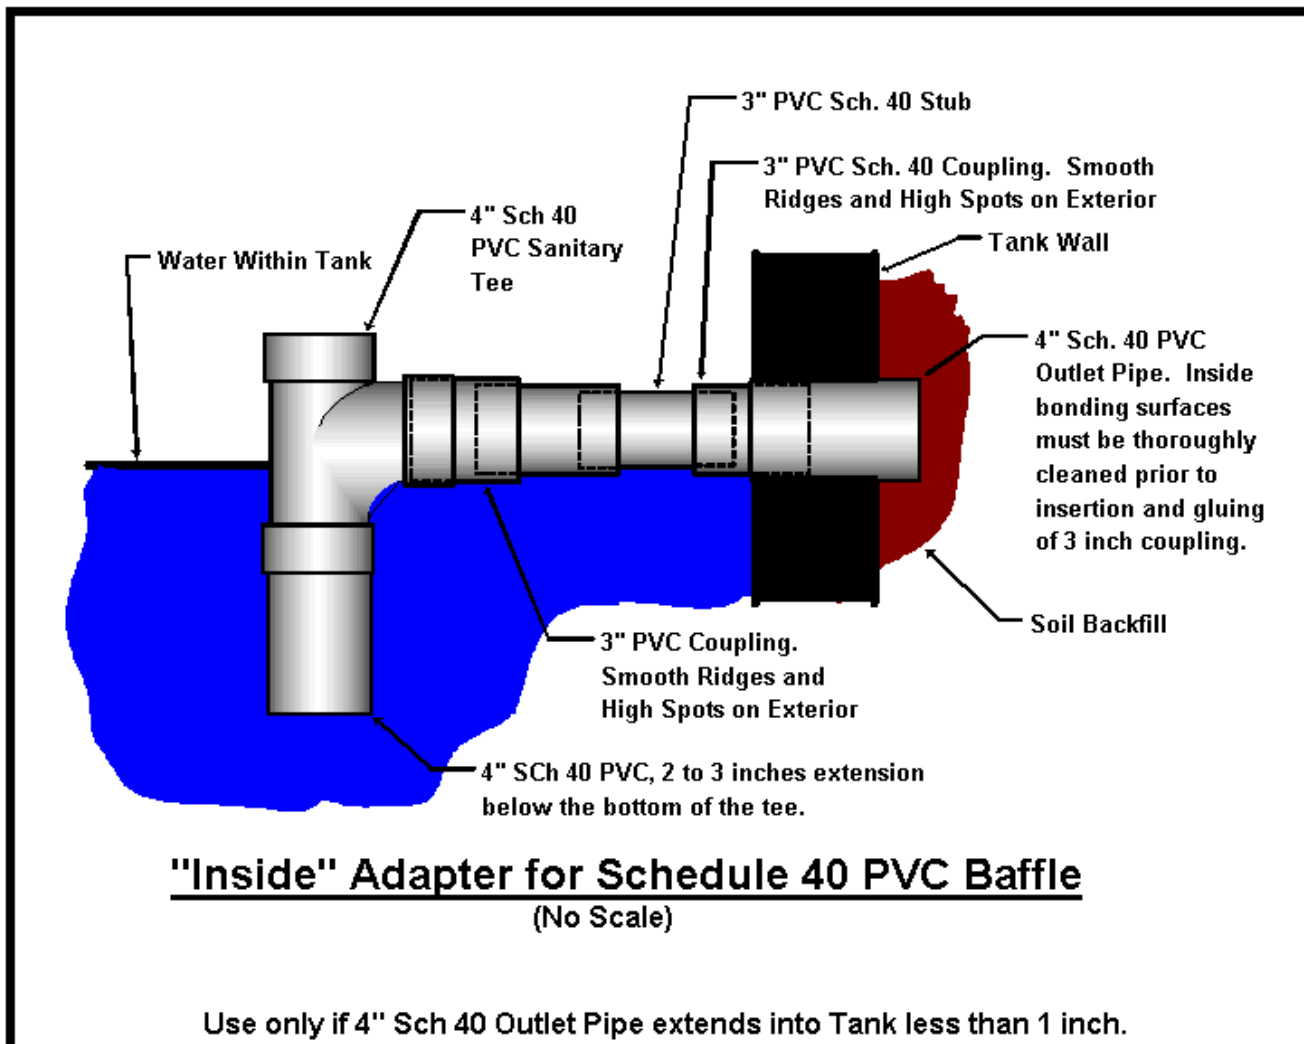

CLERMONT COUNTY GENERAL HEALTH DISTRICT		
Division of Water & Waste		
Title: Broken Baffle Fact Sheet - Less Than 1 Inch of Pipe		
Drawn By: GMV	Date: 9/5/04	Revision #: 1.0